


TAKOTNA TRIBAL COUNCIL

TAKOTNA WASHETERIA FILTER AND SEPTIC

TAKOTNA, ALASKA

35% DESIGN DRAWINGS
OCTOBER 03, 2013

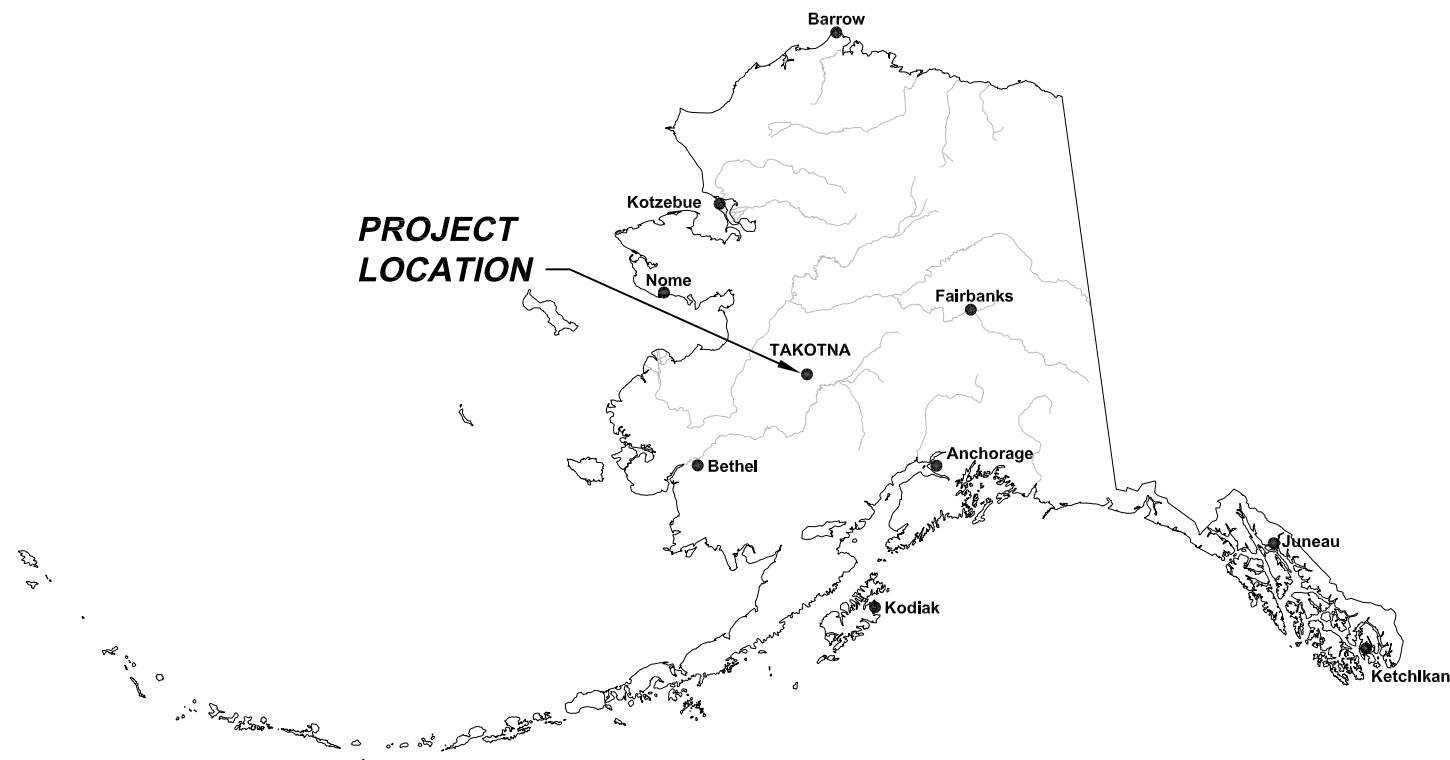


INDEX TO DRAWINGS

COVER SHEET

CIVIL


- C-1 WASHETERIA DEMOLITION PLAN
- C-2 WASHETERIA SITE PLAN, FLOW DIAGRAM AND GENERAL NOTES
- C-3 SEPTIC SITE PLAN
- C-4 SEPTIC DETAILS

CONSULTANTS

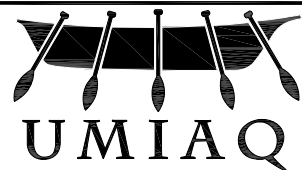

6700 Arctic Spur Road - Anchorage, AK 99518 - (907) 877-8220

FILE: Mr. \Design \Engineering \PROJECTS\70108.13 Takotna Washeteria Filter and Septic \DESIGN\Drawings\CIVIL\70108.13 Washeteria Demo.dwg
PRINTED: 10/03/2013 14:21 David Hardy LAYOUT: Layout 1

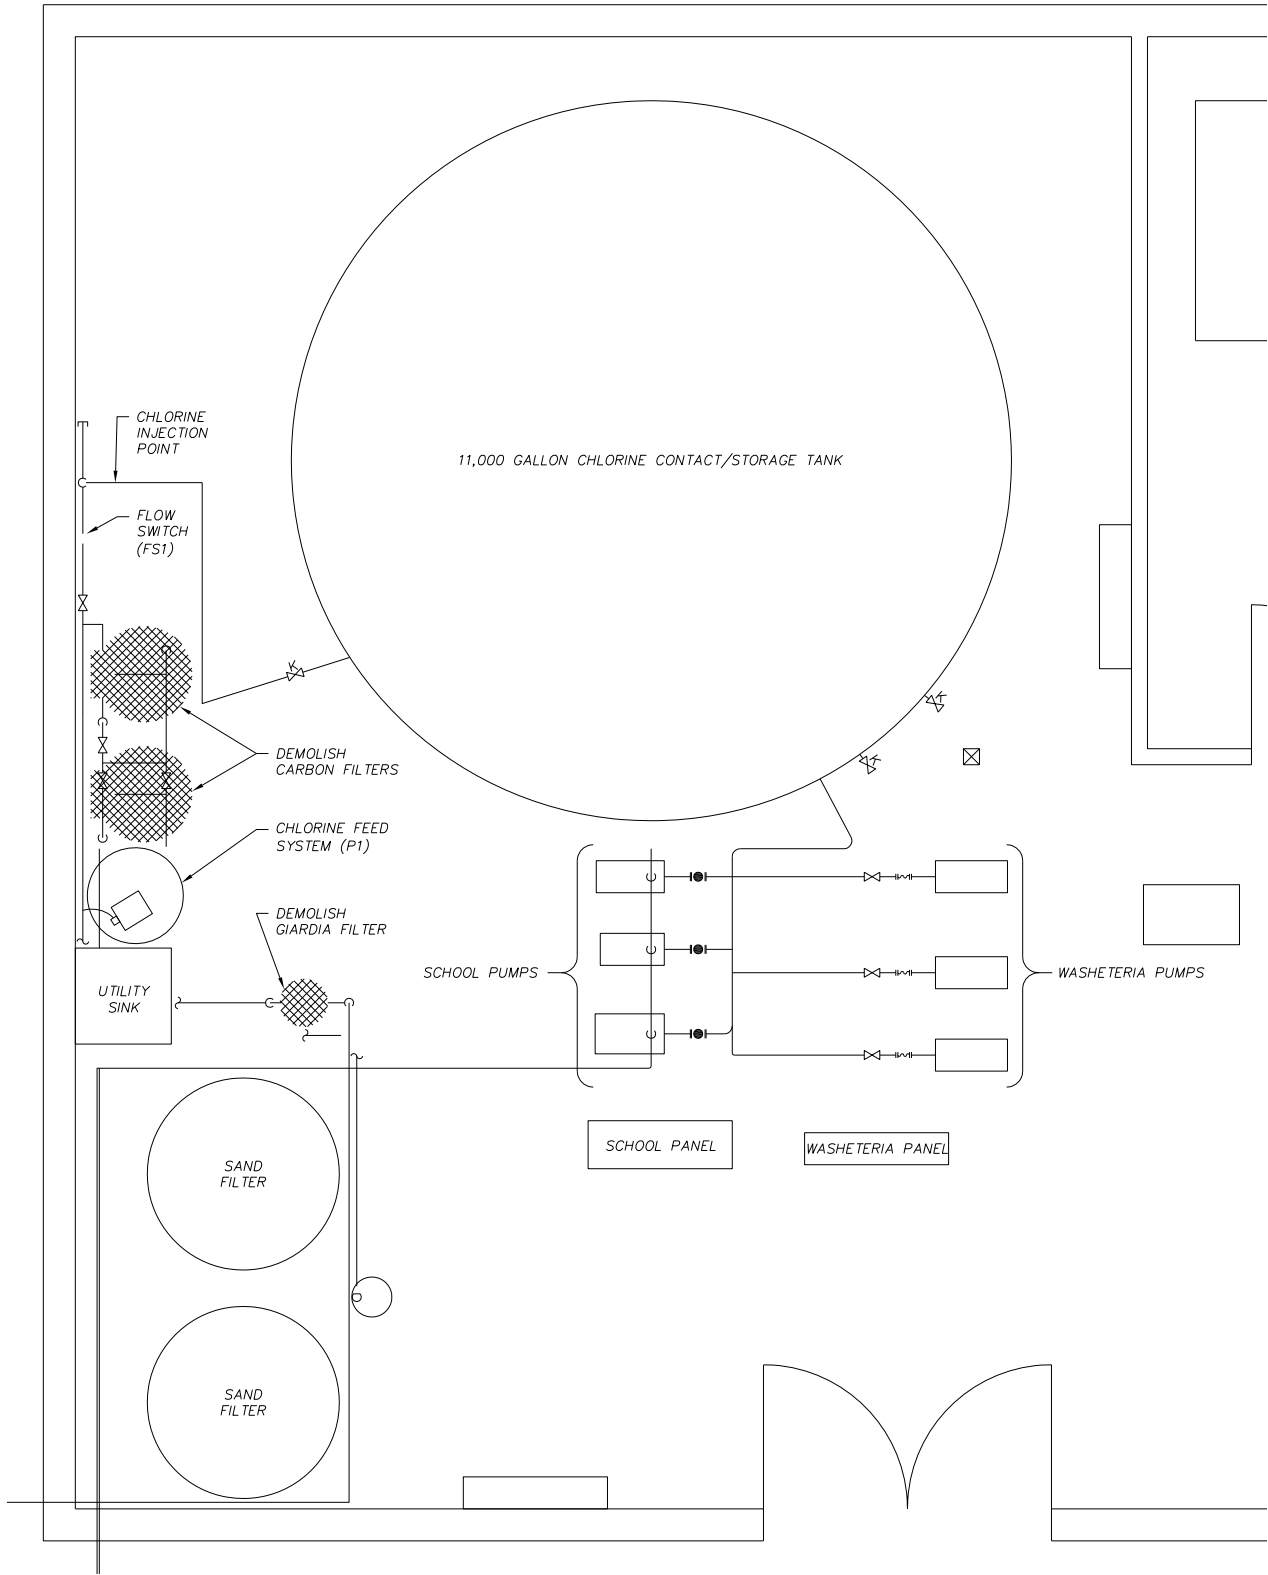


1
C-1

DEMOLITION PLAN

SCALE: N.T.S.

NOTES

1. REMOVE EXISTING GIARDIA FILTER AND PRESSURE GAUGE.
2. REMOVE TWO EXISTING CARBON FILTER AND ASSOCIATED HARDWARE. VALVES FROM RAW WATER LINE TO REMAIN.
3. DO NOT REMOVE OR DAMAGE BACKWASH LINES OR VALVES.

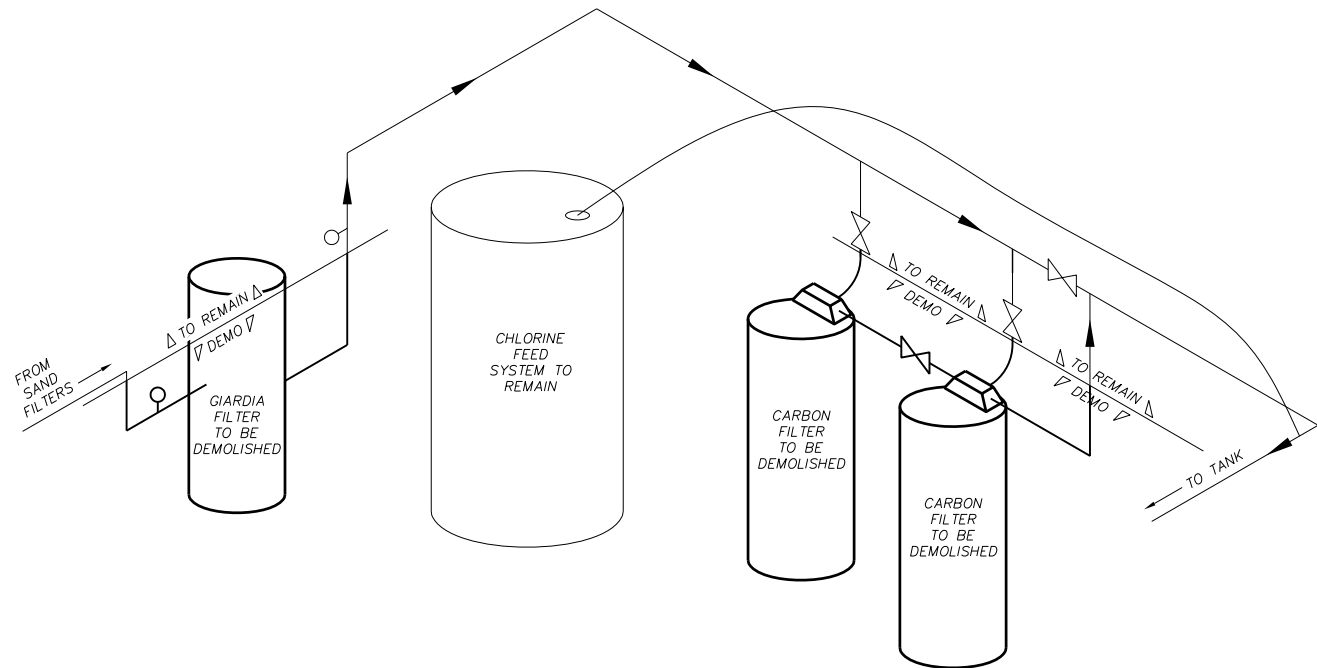


2
C-1

DEMOLITION SCHEMATIC

SCALE: N.T.S.

TAKOTNA TRIBAL COUNCIL

**TAKOTNA WASHETERIA FILTER AND SEPTIC
TAKOTNA, ALASKA**



**35% DESIGN
DOCUMENTS**


REVISIONS:

DRAWN BY: MAR
CHECKED BY: DH
DATE: 10/3/2013
JOB NUMBER: 70108.13
SCALE: AS SHOWN

DRAWING TITLE:
WASHETERIA
DEMOLITION PLAN

SHEET: OF
C-1

FILE: M:\Design\Engineering\PROJECTS\70108.13 Takotna Washeteria Filter and Septic\DESIGN\Drawings\CIVIL\70108.13 Washeteria Plan.dwg
PRINTED: 10/03/2013 14:22 David Hardy LAYOUT: Layout 1

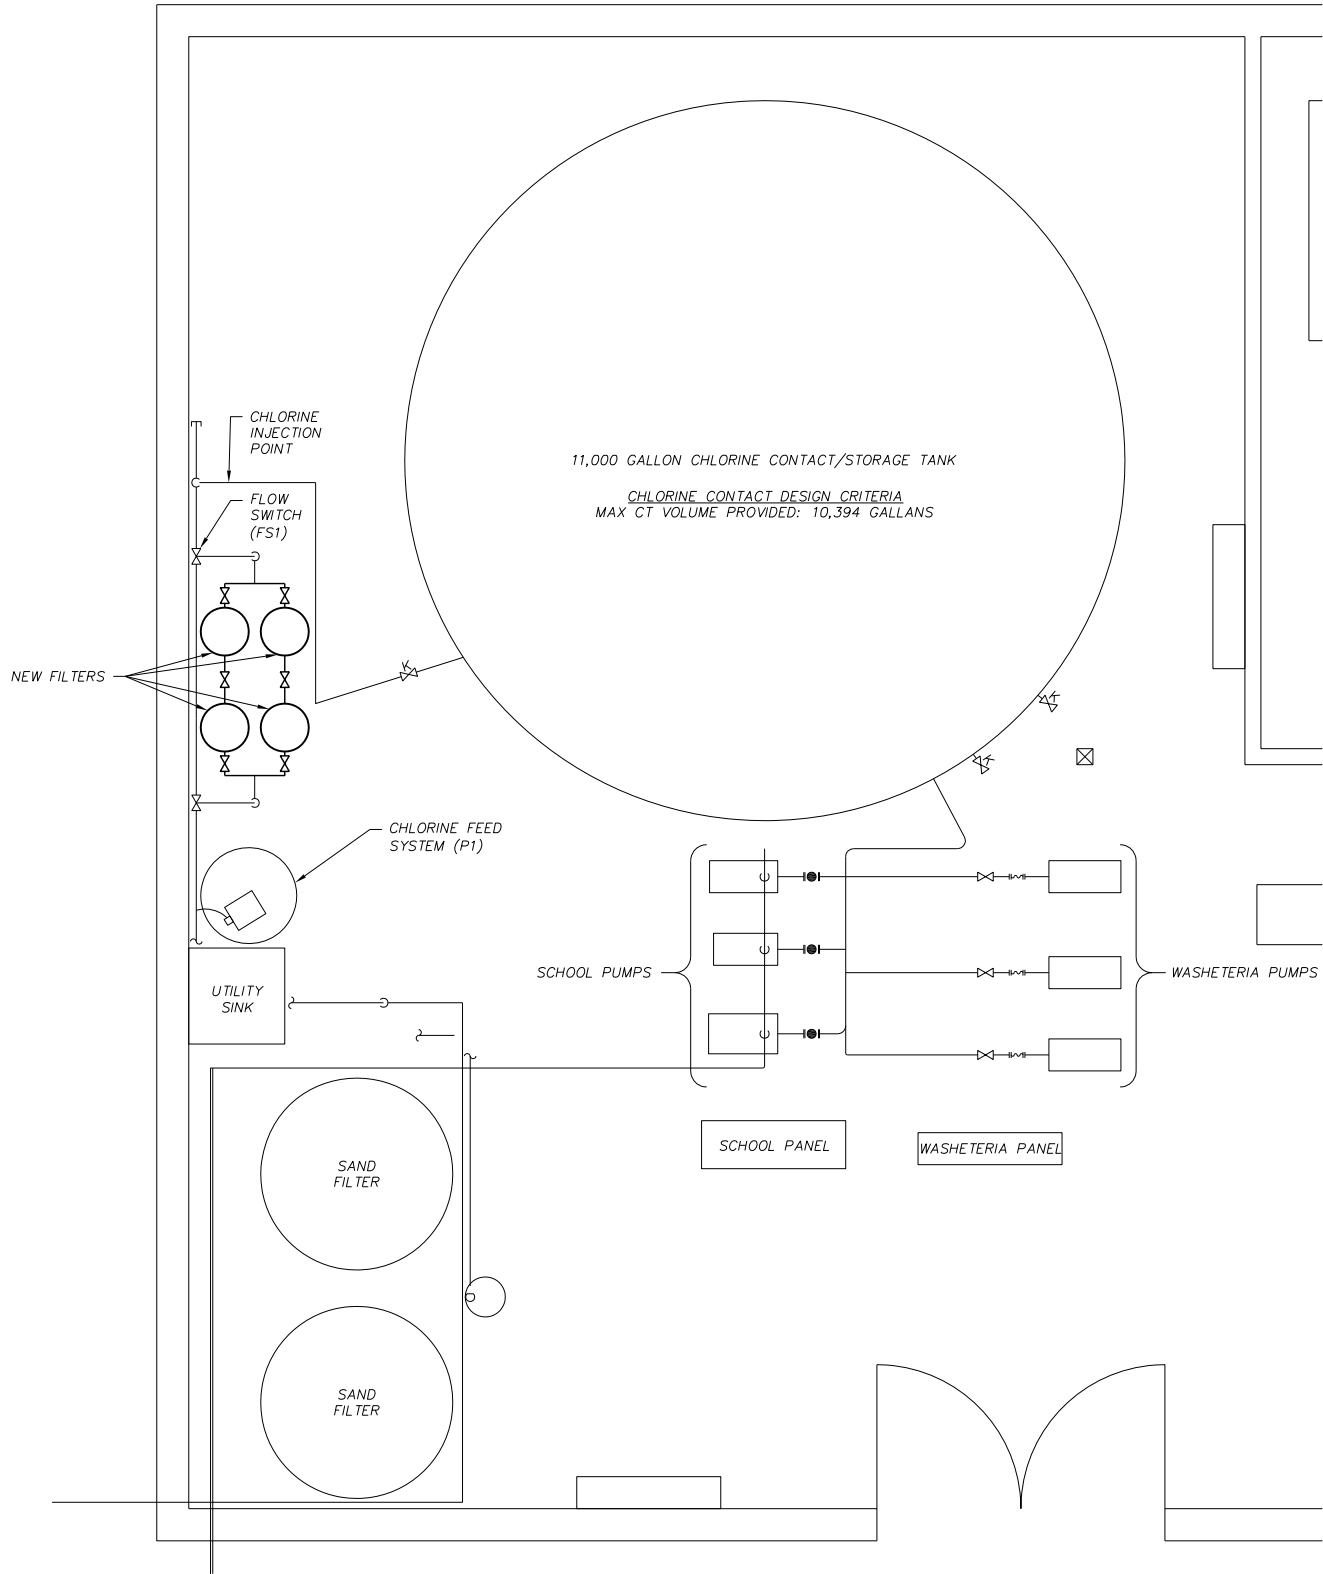

GENERAL NOTES

- ALL ADDITIVES AND MATERIALS USED FOR THE POTABLE WATER SYSTEM SHALL BE APPROVED FOR USE BY THE NATIONAL SANITATION FOUNDATION (NSF) STANDARDS, NSF 61, NSF 53, AS APPLICABLE..
- ALL MATERIALS FOR THE POTABLE WATER SYSTEM SHALL BE LEAD-FREE. ONLY LEAD FREE PIPE, FLUX, AND SOLDER SHALL BE USED.
- DESIGN DRAWINGS ARE SCHEMATIC IN NATURE, THEY ARE NOT INTENDED TO BE DETAILED DRAWINGS.
- PROVIDE AIR GAPS AS REQUIRED BY PLUMBING CODE.
- PROVIDE BACKFLOW AND CROSS CONNECTION CONTROL PER 18AAC80.
- PIPING SHOWN IS SCHEDULE 40 PVC.

SCOPE OF WORK

- DEMOLISH EXISTING GIARDIA FILTER AND CARBON FILTERS AS SHOWN ON SHEET C-1.
- INSTALL STAGE ONE AND STAGE TWO FILTERS AND ASSOCIATED VALVES AND PIPING.
- DISINFECT SYSTEMS AND DISPOSE OF NEUTRALIZED WATER PER THE REQUIREMENTS OF ANSI/AWA C651, C652, C653 AS APPLICABLE. PRESSURE TESTING MAY BE COINCIDENT PER ANSI/AWWAC605.
- UPON COMPLETION OF WORK, PERFORM TOTAL COLIFORM TESTING PER ADEC REQUIREMENTS PRIOR TO ESTABLISHMENT OF SERVICE TO WATER SYSTEM.

DESIGN CRITERIA

WATER SOURCE: SURFACE

POPULATION*:
CURRENT: 50
DESIGN: 100

PER CAPITA WATER USE*:
WATERING POINT: 19 GPCPD (RECENT)
WATER DISTRIBUTION: 55 GPCPD (FUTURE)

AVERAGE DAILY DEMAND*:
CURRENT: 950 GPD
WASHETERIA: 627 GPD
SCHOOL: 1,577 GPD
TOTAL: 5,500 GPD
FUTURE:

MAXIMUM DAILY DEMAND*:
CURRENT: 3,154 GPD
FUTURE: 16,254 GPD

PEAK HOURLY DEMAND*:
CURRENT: 5.9 GPM (CURRENT MAXIMUM FILTRATION RATE: 7 GPM)
FUTURE: 21 GPM

PEAK INSTANTANEOUS DEMAND*:
CURRENT: 55 GPM
FUTURE: 100 GPM

SOURCE PUMPING RATE*: 37 GPM

CT TREATMENT:
THE SYSTEM CAN MEET THE CT REQUIREMENTS FOR NORMAL AVERAGE AND PEAK FLOW RATES (12 GPM AND 45 GPM RESPECTIVELY). ASSUMING A WATER TEMPERATURE OF 5 DEGREES CELSIUS, BAFFLE FACTOR OF 10%, 0.5 LOG TREATMENT, pH OF 6.5, AND A MINIMUM WATER STORAGE CAPACITY OF 7,800 GALLONS, THE SYSTEM CAN ADJUST FREE CHLORINE LEVELS TO MEET CT REQUIREMENTS. AT 12 GPM FLOW RATE, THE SYSTEM WOULD HAVE TO MAINTAIN 0.3 MG/L FREE CHLORINE. AT 45 GPM FLOW RATES, THE SYSTEM WOULD HAVE TO MAINTAIN 1.2 MG/L FREE CHLORINE.


PRE-FILTERS:
SAND FILTERS ARE INSTALLED BEFORE THE TANKS TO REMOVE SILT AND LARGE PARTICLES PRIOR TO THE TREATMENT UNITS.

PROPOSED FILTERS:
STAGE 1:
TWO (2) MUNI-1-2FL-304 MUNICIPAL HURRICANE FILTRATION SYSTEM CARTRIDGES WITH HC/170-5 HURRICANE HIGH PERFORMANCE FILTERS MANUFACTURED BY HARMSCO MUNICIPAL, OR APPROVED EQUAL.

STAGE 2:
TWO (2) MUNI-1-2FL-304 MUNICIPAL HURRICANE FILTRATION SYSTEM CARTRIDGES WITH HC/170-LT2 HURRICANE ABSOLUTE RATED FILTERS MANUFACTURED BY HARMSCO MUNICIPAL OR APPROVED EQUAL.


* DATA FROM G.V. JONES WATER PLANT UPGRADE DESIGN - 1/6/2004

TARGET PATHOGEN	SYSTEM AS DESIGNED				REQUIRED
	PRE-FILTERS (SAND FILTERS)	FILTRATION (FLOPLUS 10BB)	INACTIVATION (CHLORINATION)	TOTAL	
GIARDIA LAMBLIA	0.0-LOG	2.5-LOG	0.5-LOG	3.0-LOG	3.0-LOG
CRYPTOSPORIDIUM	0.0-LOG	2.0-LOG	0.0-LOG	2.0-LOG	2.0-LOG
VIRUSES	0.0-LOG	0.0-LOG	4.0-LOG	4.0-LOG	4.0-LOG

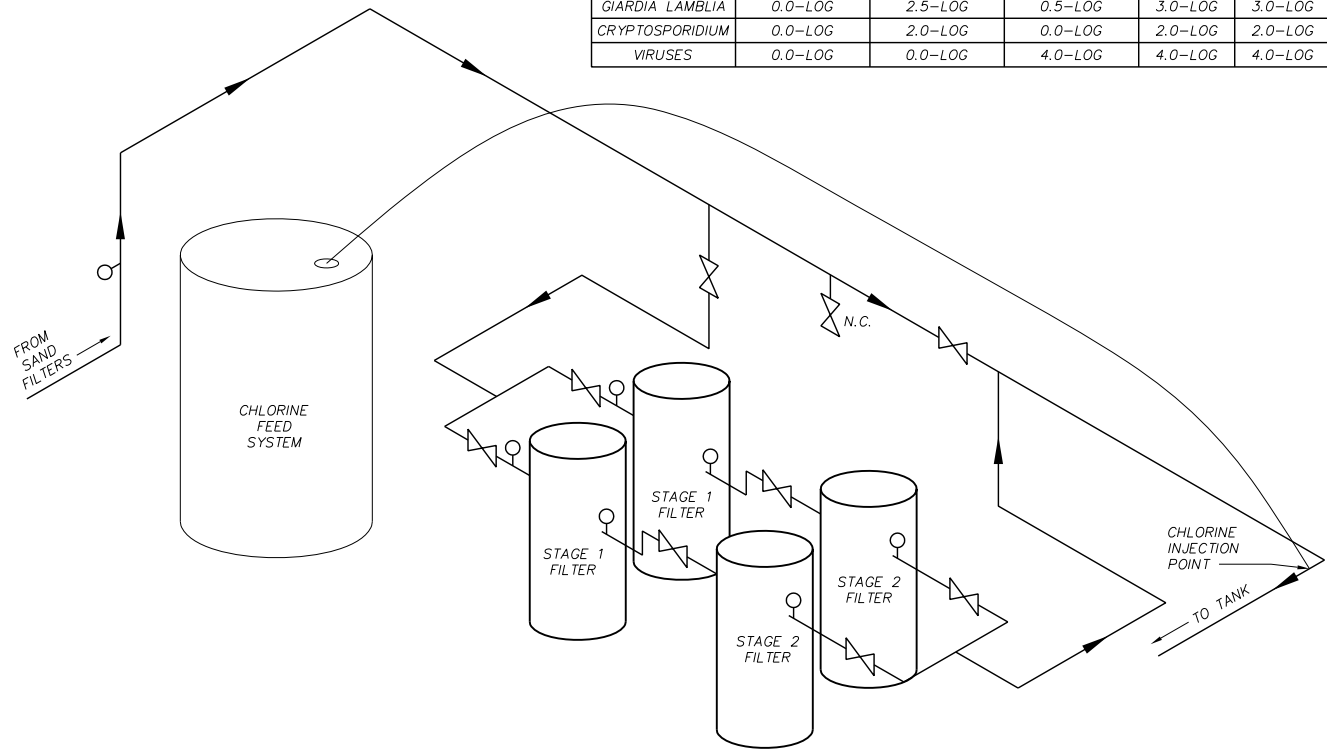

TAKOTNA TRIBAL COUNCIL

TAKOTNA WASHETERIA FILTER AND SEPTIC
TAKOTNA, ALASKA



35% DESIGN
DRAWINGS

REVISIONS:


DRAWN BY: MAR
CHECKED BY: DH
DATE: 10/3/2013
JOB NUMBER: 70108.13
SCALE: AS SHOWN

DRAWING TITLE:
WASHETERIA SITE PLAN,
FLOW DIAGRAM AND
GENERAL NOTES

SHEET: OF
C-2

ABSORPTION SYSTEM DESIGN CRITERIA

1. AVERAGE WASTEWATER FLOW = 500 GPD
2. WATER SYSTEM BACKWASH:
A 3,500 GALLON SURGE TANK WILL BE PROVIDED TO COLLECT THE BACKWASH FROM THE SAND FILTERS AND EMPTY IN 7 DAYS.
BACKWASH QUANTITY = 3,000 GAL ONCE A MONTH
FLOW RATE FROM SURGE TANK = 430 GPD
3. TOTAL WASTEWATER FLOW = 930 GPD
4. MAXIMUM WASTEWATER APPLICATION RATE = 1.2 GAL/SQ FT/DAY
5. SOIL ABSORPTION SIZING WITH 1.2 FACTOR OF SAFETY:
$$\text{DRAIN FIELD AREA} = \frac{930 \text{ GPD}}{1.2 \text{ GAL/SQ FT/DAY}} = 929 \text{ SQ FT} \times 1.2 = 1114 \text{ SQ FT}$$

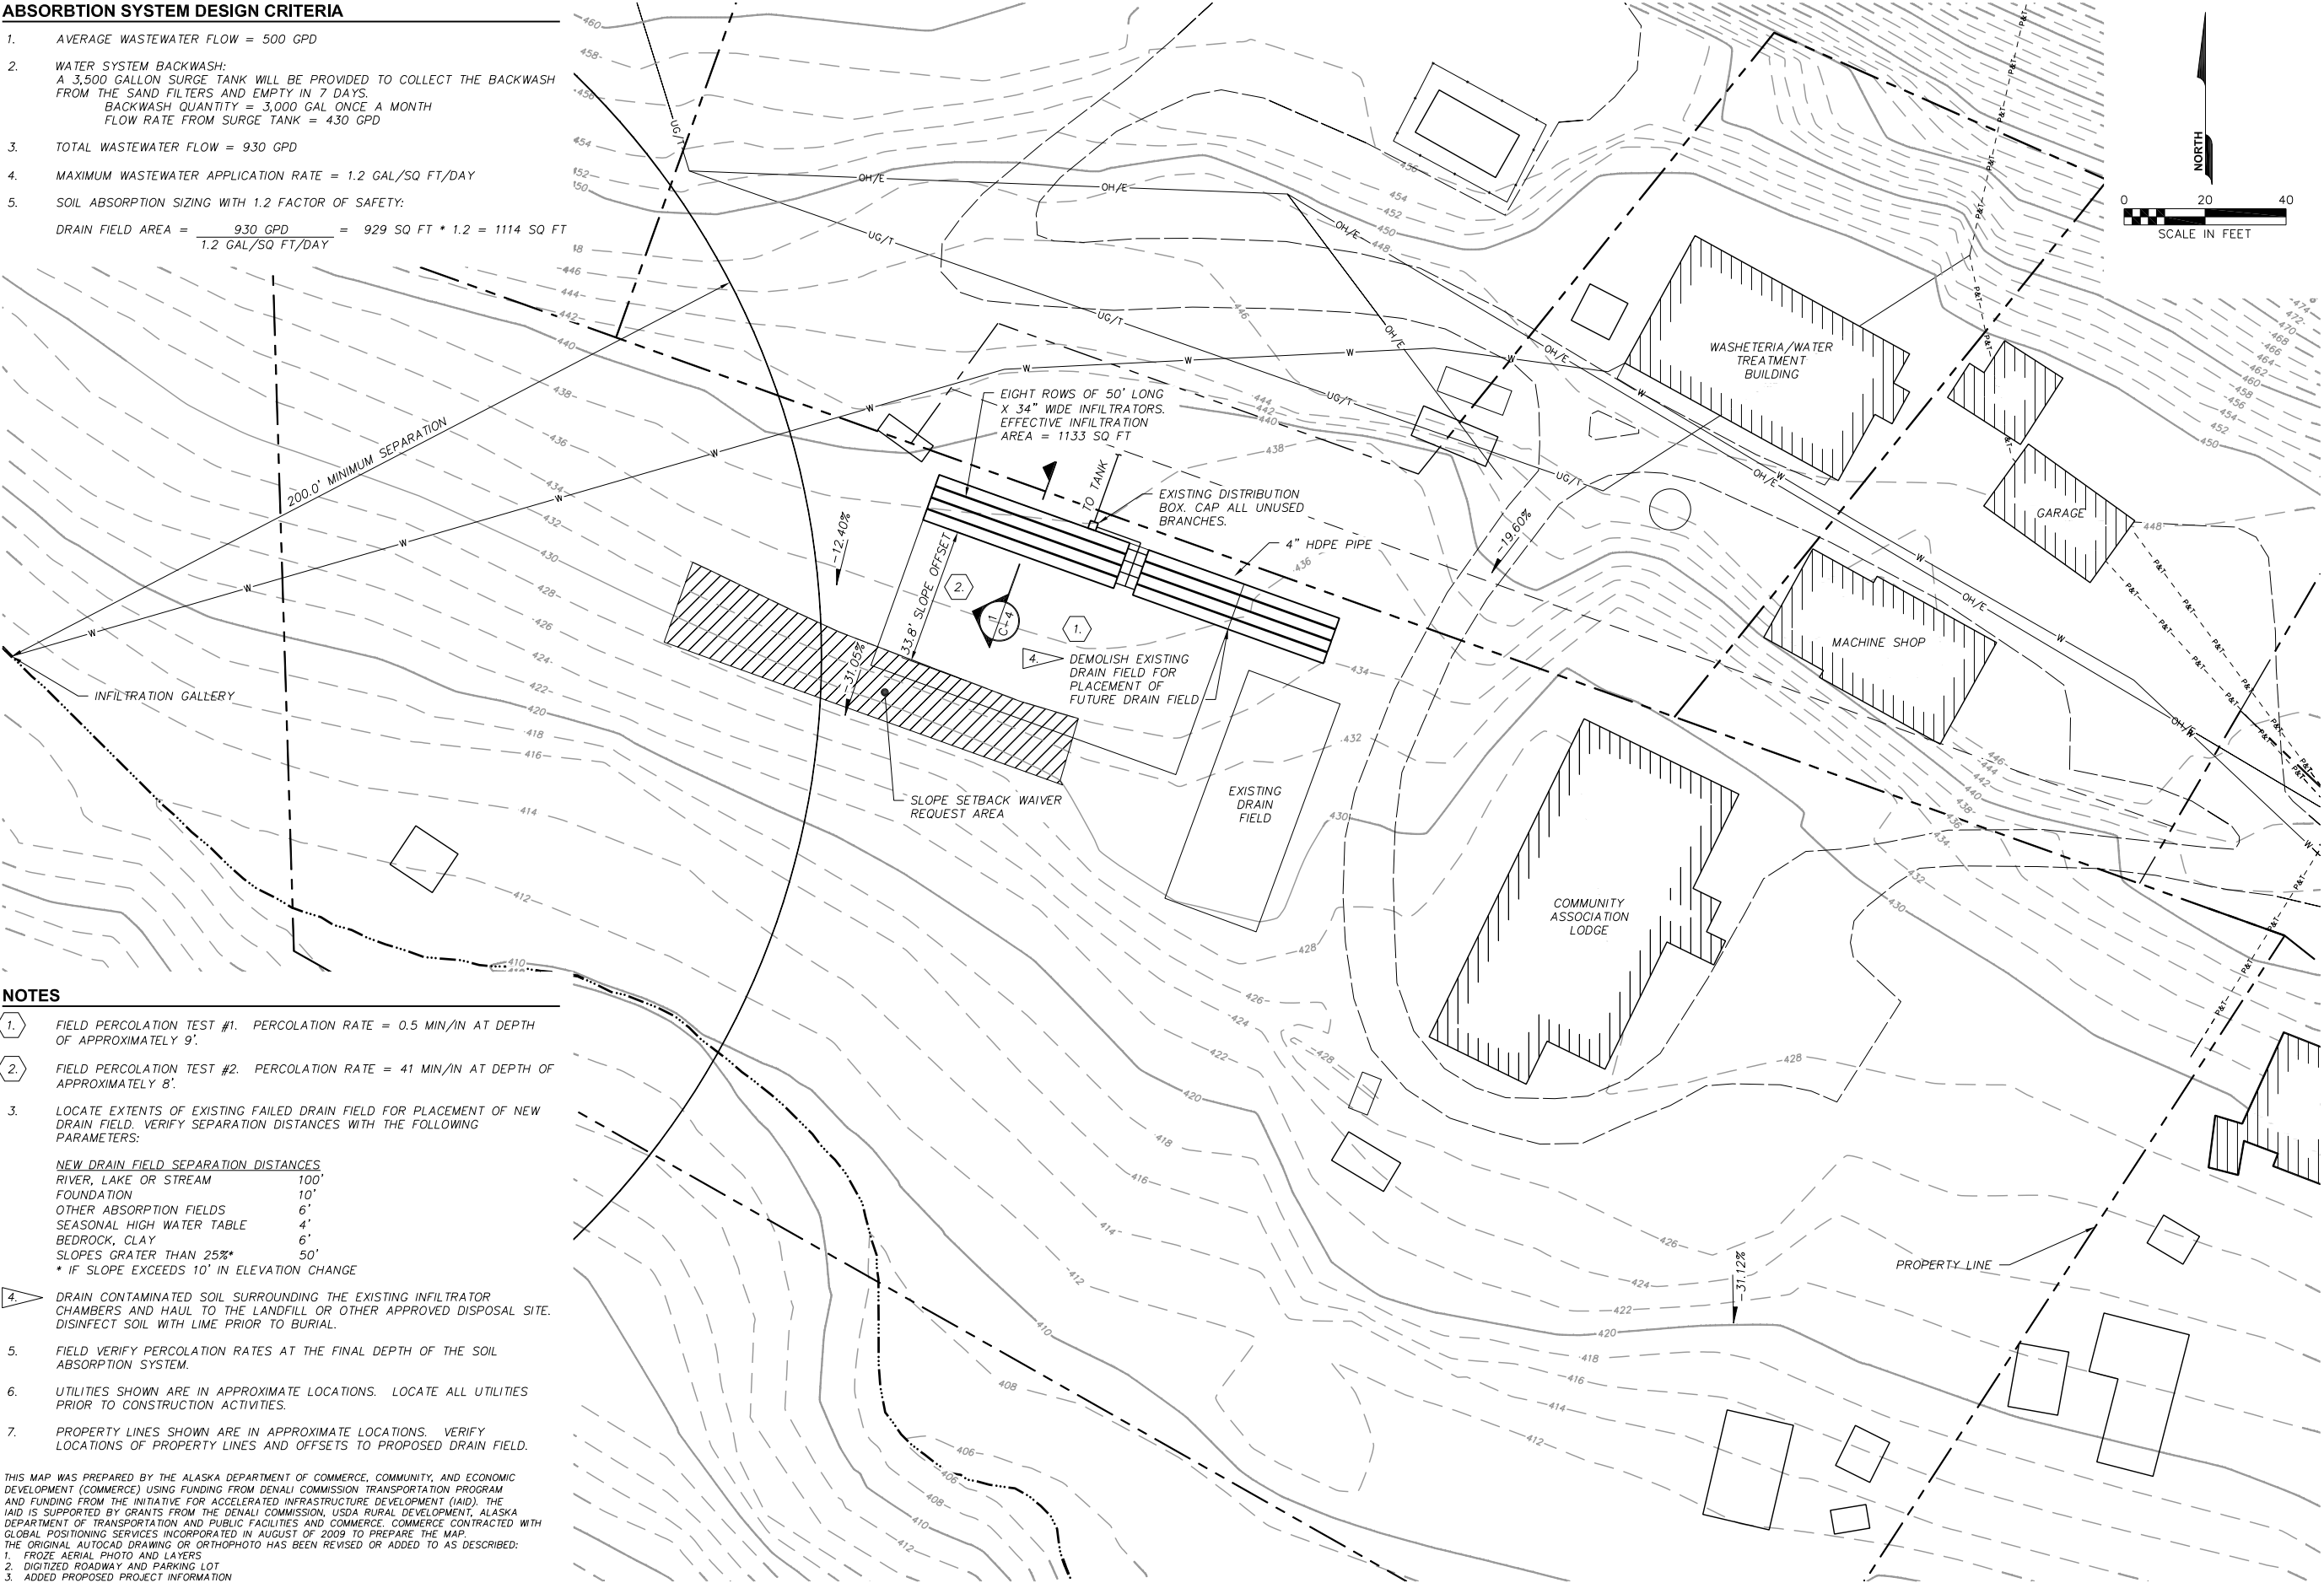


NOTES

1. FIELD PERCOLATION TEST #1. PERCOLATION RATE = 0.5 MIN/IN AT DEPTH OF APPROXIMATELY 9'.
2. FIELD PERCOLATION TEST #2. PERCOLATION RATE = 41 MIN/IN AT DEPTH OF APPROXIMATELY 8'.
3. LOCATE EXTENTS OF EXISTING FAILED DRAIN FIELD FOR PLACEMENT OF NEW DRAIN FIELD. VERIFY SEPARATION DISTANCES WITH THE FOLLOWING PARAMETERS:
NEW DRAIN FIELD SEPARATION DISTANCES
RIVER, LAKE OR STREAM 100'
FOUNDATION 10'
OTHER ABSORPTION FIELDS 6'
SEASONAL HIGH WATER TABLE 4'
BEDROCK, CLAY 6'
SLOPES GRATER THAN 25%* 50'
* IF SLOPE EXCEEDS 10' IN ELEVATION CHANGE
4. DRAIN CONTAMINATED SOIL SURROUNDING THE EXISTING INFILTRATOR CHAMBERS AND HAUL TO THE LANDFILL OR OTHER APPROVED DISPOSAL SITE. DISINFECT SOIL WITH LIME PRIOR TO BURIAL.
5. FIELD VERIFY PERCOLATION RATES AT THE FINAL DEPTH OF THE SOIL ABSORPTION SYSTEM.
6. UTILITIES SHOWN ARE IN APPROXIMATE LOCATIONS. LOCATE ALL UTILITIES PRIOR TO CONSTRUCTION ACTIVITIES.
7. PROPERTY LINES SHOWN ARE IN APPROXIMATE LOCATIONS. VERIFY LOCATIONS OF PROPERTY LINES AND OFFSETS TO PROPOSED DRAIN FIELD.

THIS MAP WAS PREPARED BY THE ALASKA DEPARTMENT OF COMMERCE, COMMUNITY, AND ECONOMIC DEVELOPMENT (COMMERCE) USING FUNDING FROM DENALI COMMISSION TRANSPORTATION PROGRAM AND FUNDING FROM THE INITIATIVE FOR ACCELERATED INFRASTRUCTURE DEVELOPMENT (IAID). THE IAID IS SUPPORTED BY GRANTS FROM THE DENALI COMMISSION, USDA RURAL DEVELOPMENT, ALASKA DEPARTMENT OF TRANSPORTATION AND PUBLIC FACILITIES AND COMMERCE. COMMERCE CONTRACTED WITH GLOBAL POSITIONING SERVICES INCORPORATED IN AUGUST OF 2009 TO PREPARE THE MAP. THE ORIGINAL AUTOCAD DRAWING OR ORTHOPHOTO HAS BEEN REVISED OR ADDED TO AS DESCRIBED:
1. FROZE AERIAL PHOTO AND LAYERS
2. DIGITIZED ROADWAY AND PARKING LOT
3. ADDED PROPOSED PROJECT INFORMATION

TAKOTNA TRIBAL COUNCIL

TAKOTNA WASHETERIA FILTER AND SEPTIC
TAKOTNA, ALASKA



35% DESIGN
DRAWINGS


REVISIONS:

DRAWN BY: DBH
CHECKED BY: MEW
DATE: 10/3/2013
JOB NUMBER: 70108
SCALE: AS SHOWN

DRAWING TITLE:
SEPTIC SITE PLAN

SHEET: 3 OF 4


C-3

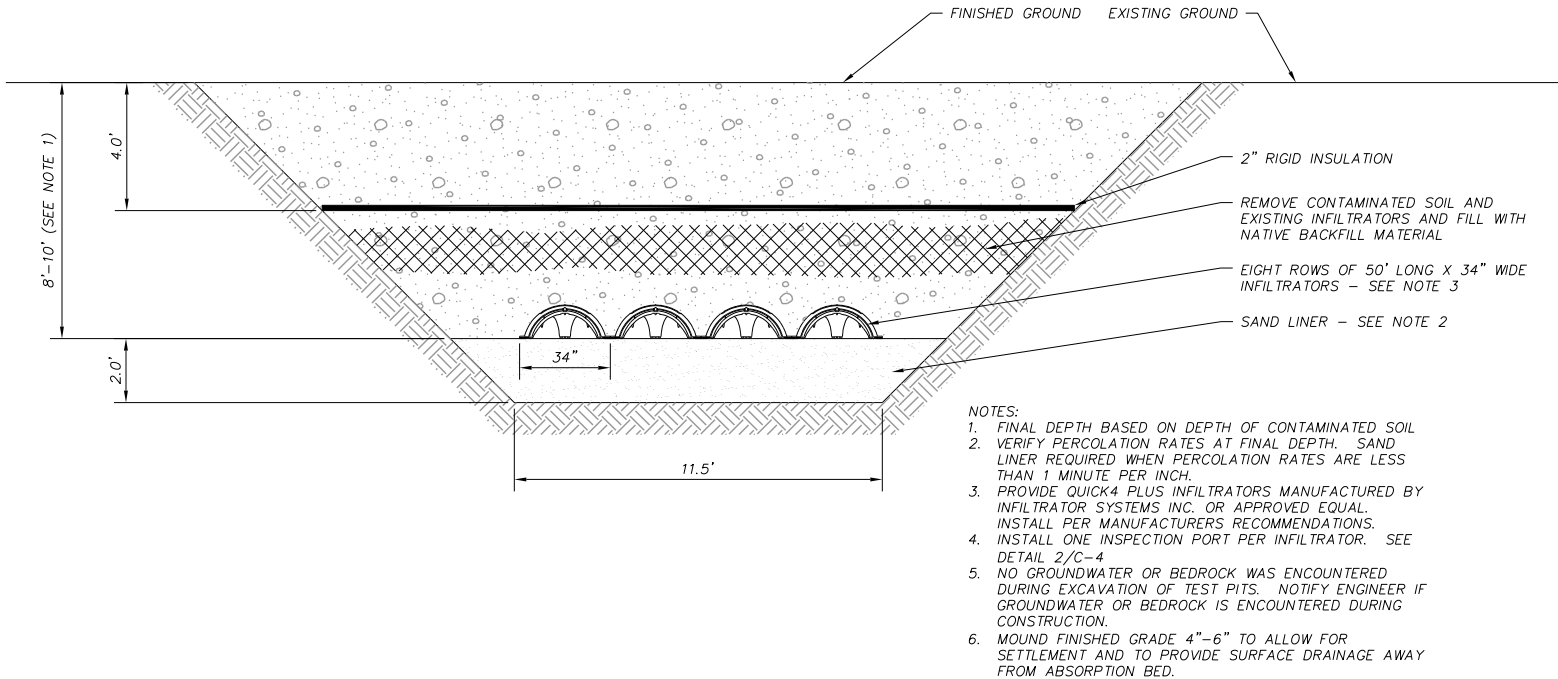

1
C-4

DRAIN FIELD SECTION

SCALE: N.T.S.

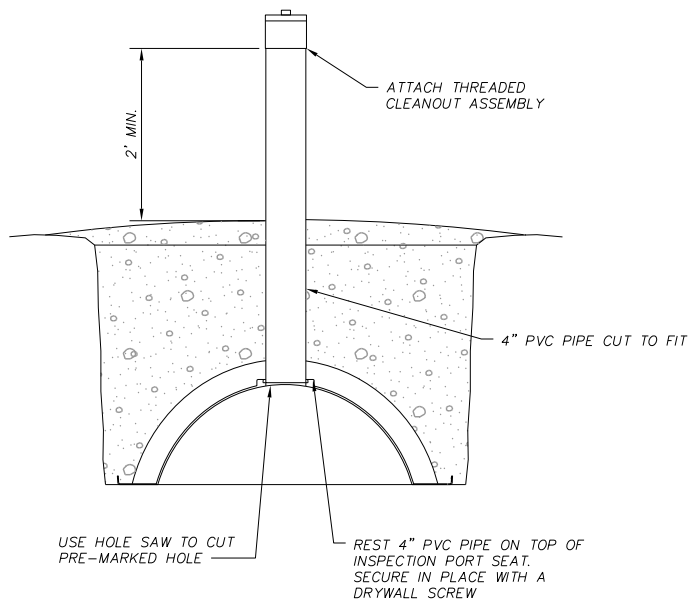

2
C-4

INSPECTION PORT DETAIL

SCALE: N.T.S.

TAKOTNA TRIBAL COUNCIL

TAKOTNA WASHETERIA FILTER AND SEPTIC
TAKOTNA, ALASKA



35% DESIGN
DRAWINGS

REVISIONS:

DRAWN BY: DBH
CHECKED BY: MEW
DATE: 10/3/2013
JOB NUMBER: 70108
SCALE: AS SHOWN

DRAWING TITLE:
SEPTIC DETAILS

SHEET: 4 OF 4

C-4