

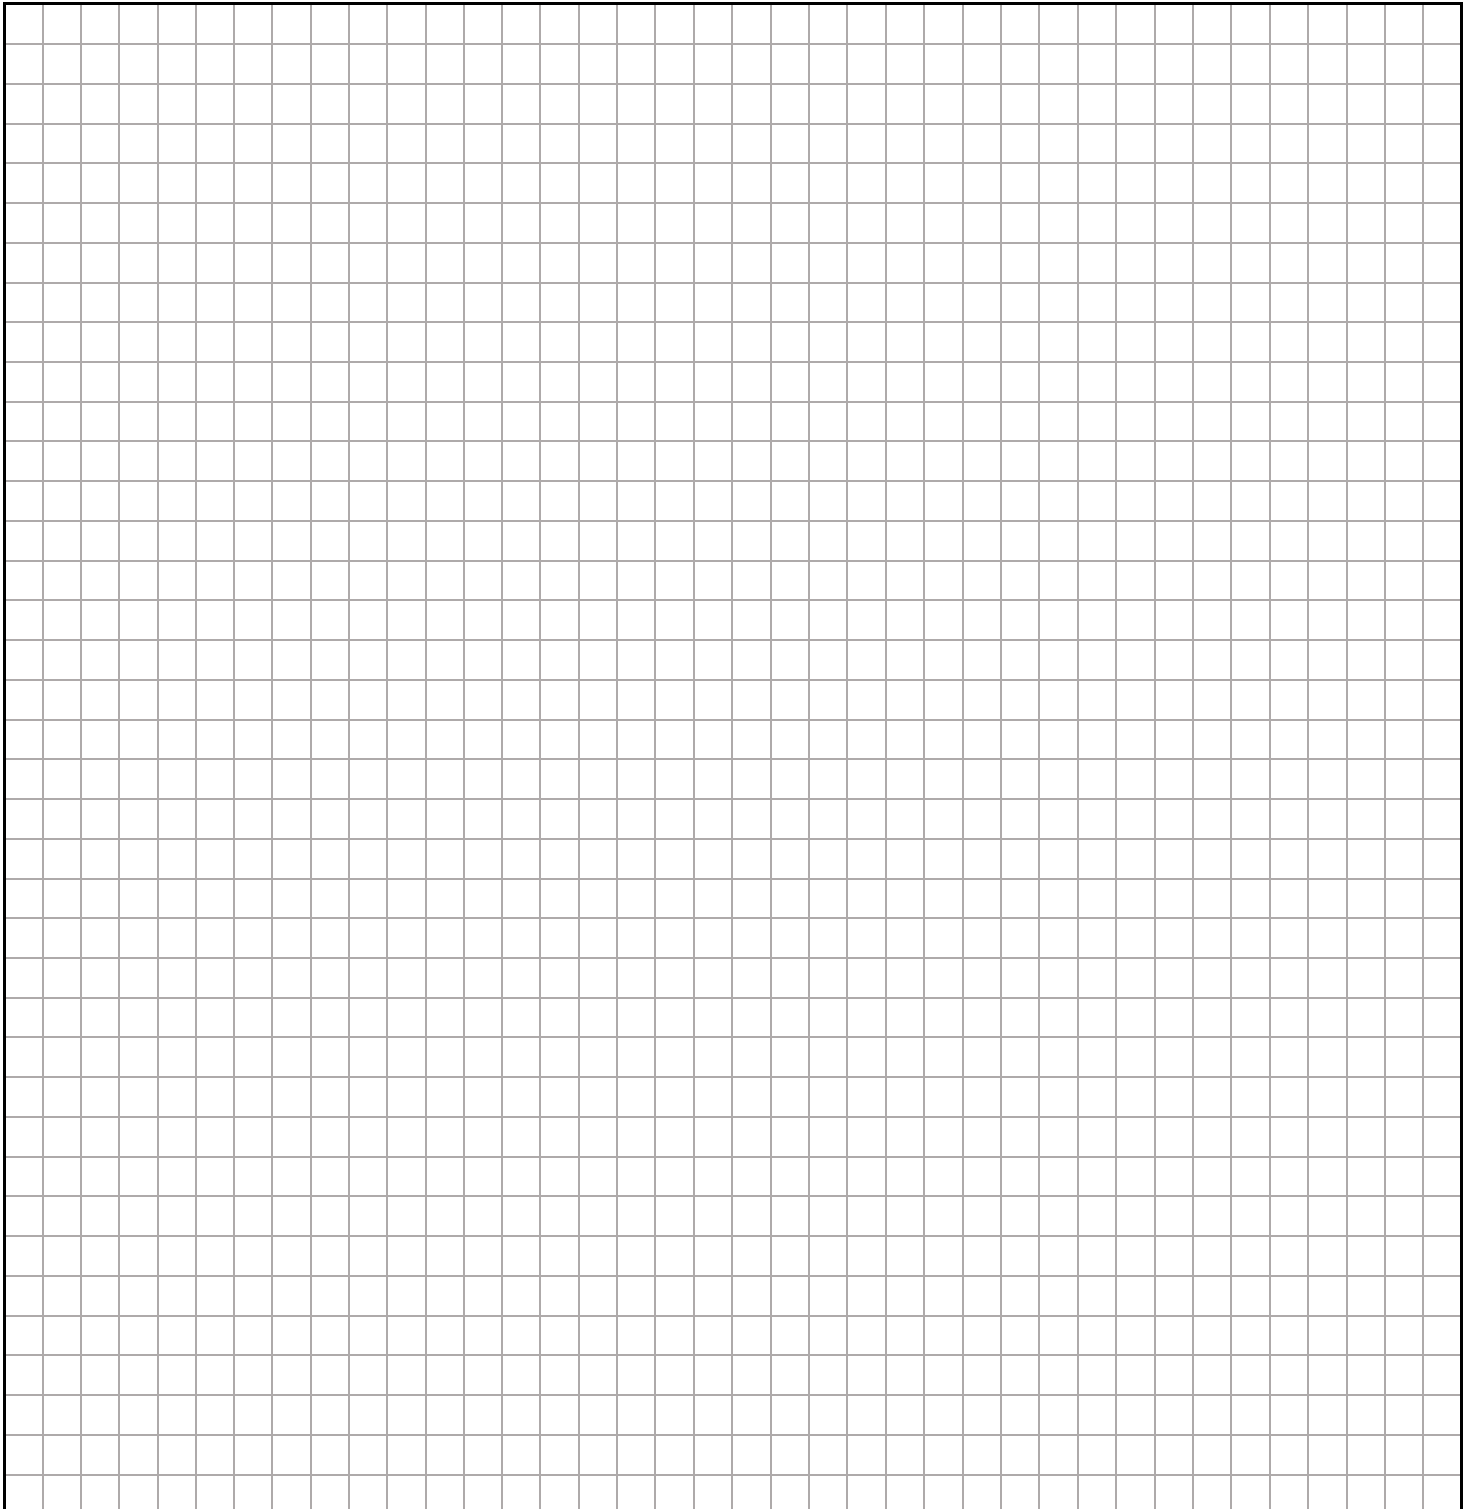
Legal Description: \_\_\_\_\_

Street Address: \_\_\_\_\_

### Part III. Plan View Diagram

**Instructions for Diagram:** (use space below or attach additional pages as necessary; engineers may attach separate sealed drawings)

1. In a PLAN VIEW, identify and label all of the following: ☐ On Lot Drinking Water Source ☐ Waterline(s) ☐ Surface Water  
☐ Septic Tank ☐ Soil Absorption System ☐ Fuel Tank(s) (identify above or below ground and size) ☐ Property Line(s) ☐ Testhole  
☐ All Sewer Lines and Perforated Pipe ☐ All Cleanouts and Monitor Tubes ☐ All Structures ☐ Slopes >25% and >10 feet in height  
☐ Closest Well on Adjacent Properties (identify classification) ☐ Closest Septic Tank and Soil Absorption System on Adjacent Properties
2. In the PLAN VIEW, label the horizontal separation distances, to the nearest half foot, between well(s), water lines, and surface water high water boundary to all potential sources of contamination listed above in accordance with Section 40.06 Typical Site Plan in the Onsite Wastewater System Installation Manual. Label separation distance between soil absorption system and slopes exceeding 25%. Label the size of each septic system component using appropriate units. Identify fittings used at bends and junctions.

A large grid area for drawing the Plan View Diagram. The grid is composed of small squares, providing a scale for the drawing. It is intended for the engineer to draw the site plan, showing property lines, water lines, septic tanks, and other features as required by the instructions.